


CATERPILLAR® SWITCHGEAR TEST CERTIFICATE OF SEISMIC WITHSTAND CAPABILITY

Caterpillar Paralleling Switchgear identified below was tested for seismic withstand capability and tested in accordance with the combined requirements in the International Building Code, California Building Code and the Uniform Building Code. As required by the codes, the equipment demonstrated its ability to function after the seismic tests. The seismic capability of the equipment exceeds the worst case required levels, as illustrated in the figure below.

Metal-Enclosed Low Voltage Paralleling Switchgear with Type MDS Circuit Breakers and Caterpillar Generator Control Systems Based on PLC Automation

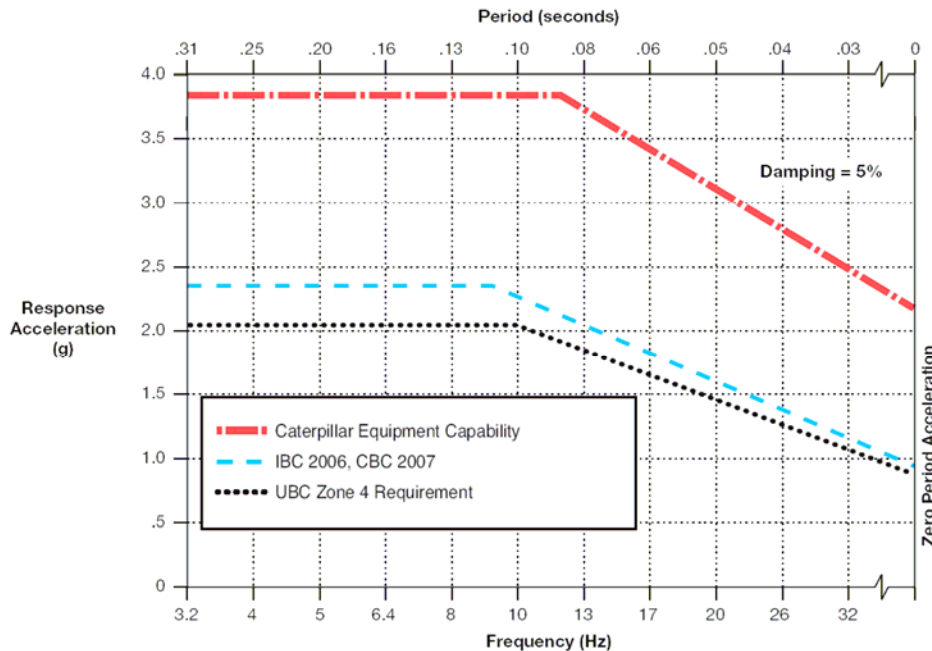

The frequency sweep tests revealed that the lowest equipment natural frequency is:

6.2 Hz

Nathan Glenn
3RD PARTY TEST ENGINEER IN CHARGE

Nathan Glenn, PE
Westinghouse Electric Company, LLC

TESTED BY
Wyle Laboratories
September, 2008 – 55906R08-5B

Information contained in this publication may be considered confidential. Discretion is recommended when distributing. Materials and specifications are subject to change without notice.

CAT, CATERPILLAR, their respective logos, "Caterpillar Yellow," and the POWER EDGE trade dress, as well as corporate and product identity used herein, are trademarks of Caterpillar and may not be used without permission.

<http://www.cat-electricpower.com/>